

Lal Lal Wind Farm

Pre-construction Noise Assessment

S5464C11

June 2018

sonus.

Prepared by

Reviewed by

s33(1)

www.sonus.com.au

© Sonus Pty Ltd. All rights reserved.

This report may not be reproduced other than in its entirety. The report is for the sole use of the client for the particular circumstances described in the report. Sonus accepts no responsibility to any other party who may rely upon or use this report without prior written consent.

TABLE OF CONTENTS

GLOSSARY	4
1 INTRODUCTION	5
2 LOCATION OF THE WIND FARM AND THE SURROUNDING RESIDENCES.....	6
3 RELEVANT NOISE LIMITS	10
4 NOISE PREDICTION MODELS	11
4.1 Warranted Sound Power Levels.....	11
4.2 ISO 9613.2 Noise Prediction Model Using IOA Inputs	11
4.3 ISO 9613.2 Noise Prediction Model Using NZS6808:2010 Inputs.....	12
4.4 Predicted Wind Turbine Operational Noise	12
5 VESTAS CURTAILMENT STRATEGY	13
5.1 ISO9613.2 Noise Propagation Model with IOA inputs	15
5.2 ISO9613.2 Noise Propagation Model with New Zealand Standard Inputs	17
5.3 ISO9613.2 Noise Propagation Model with Hard Ground	19
APPENDIX A: Lal Lal Wind Farm General Layout	21
APPENDIX B: Vestas Sound Power Level Data	23
APPENDIX C: Predicted Noise Levels	29

GLOSSARY

A weighting	Frequency adjustment representing the response of the human ear.
Ambient noise level	Noise level in the absence of the noise from the wind farm.
dB(A)	A weighted noise level measured in decibels.
L_{A90}	The A weighted sound pressure level that is exceeded for 90 per cent of the time over which a given sound is measured. The L_{A90} measured over a 10 minute time period is commonly termed “background sound level” and “post-installation sound level” with respect to wind farms
L_{Aeq}	The A weighted equivalent continuous noise level – the energy-average of noise levels occurring over a measurement period.
NZS6808:2010	New Zealand Standard NZS 6808:2010 Acoustics – The assessment and measurement of sound from wind turbine generators
May 2013 UK IOA Good Practice Guide	UK Institute of Acoustics IOA A Good Practice Guide To The Application Of Etsu-R-97 For The Assessment And Rating Of Wind Turbine Noise

1 INTRODUCTION

An environmental noise assessment at the planning approval stage of the Lal Lal Wind Farm in Victoria was conducted by Marshall Day. The project was granted approval for the operation and construction of the Wind Farm subject to a number of conditions.

Following approval, background noise monitoring was conducted by Marshall Day and is summarised in the draft report with reference "Report No.001 01Draft 20170649". The background noise report summarises the measured background noise levels at 7 locations and provides the operational environmental noise criteria at these locations.

This report summarises an assessment of the prediction of noise from the proposed operation of 60 Vestas V136, 3.8MW turbines. The assessment includes:

- Prediction of the noise from the proposed wind farm using the ISO9613.2 noise model and the inputs recommended by the IOA Good Practice Guide;
- Prediction of the noise from the proposed wind farm using the ISO9613.2 noise model and the inputs of New Zealand Standard NZS6808:2010;
- Prediction of the noise from the wind farm when operating under a revised curtailment strategy proposed by Vestas using the following noise models:
 - ISO9613.2 noise model using the IOA inputs;
 - ISO9613.2 noise model using the inputs of NZS6808:2010; and
 - ISO9613.2 noise model using hard ground.

The Planning Permit requires a Noise Compliance Assessment following the construction of the wind farm as well as requirements related to Noise Compliance Enforcement. Therefore, irrespective of the accuracy of the noise models, the wind farm will be required to comply with the noise criteria of the permit.

2 LOCATION OF THE WIND FARM AND THE SURROUNDING RESIDENCES

The coordinates of the final turbine layout and the residences in the vicinity of the wind farm are provided in Table 1 and Table 2, respectively.

The residences in the vicinity of the wind farm are also identified in the map provided as Appendix A.

Table 1: Coordinates of turbines.

Turbine ID	Coordinates (GDA 94 MGA Zone 54)	
	Easting	Northing
ESWT01	233512	5817821
ESWT02	233853	5818217
ESWT03	234084	5817161
ESWT04	234368	5817513
ESWT05	234648	5817731
ESWT06	235028	5817842
ESWT07	236515	5818378
ESWT08	236876	5818621
ESWT10	234101	5815965
ESWT11	234393	5816255
ESWT12	234695	5816555
ESWT13	234979	5816876
ESWT14	234744	5815988
ESWT15	235337	5816007
ESWT16	236903	5817482
ESWT17	236699	5816524
ESWT18	236972	5816736
ESWT19	237212	5817071
ESWT20	237353	5817401
ESWT21	237536	5817719
ESWT23	233785	5815068
ESWT24	233928	5815408
YSWT01	235749	5834082
YSWT02	236335	5834001
YSWT03	237895	5834026
YSWT05	237479	5833611
YSWT06	237758	5833776
YSWT07	236374	5833239
YSWT08	236947	5833151
YSWT09	237383	5833222
YSWT10	236427	5832689

Turbine ID	Coordinates (GDA 94 MGA Zone 54)	
	Easting	Northing
YSWT11	236867	5832295
YSWT12	237362	5832449
YSWT13	237778	5832435
YSWT14	237721	5831776
YSWT15	237577	5831353
YSWT16	238492	5832517
YSWT17	238318	5832069
YSWT18	238663	5831739
YSWT19	238151	5831503
YSWT20	237011	5830822
YSWT21	236257	5830315
YSWT22	236743	5830314
YSWT23	236485	5829872
YSWT24	236209	5829620
YSWT25	237009	5829643
YSWT26	235970	5829179
YSWT27	236860	5829275
YSWT28	235956	5828763
YSWT29	236585	5828803
YSWT30	237553	5830953
YSWT31	237935	5831086
YSWT32	239245	5831116
YSWT33	237473	5830494
YSWT34	238063	5830698
YSWT35	238489	5830840
YSWT36	239624	5830764
YSWT38	239378	5830392
YSWT39	240083	5830399
YSWT40	239743	5830020

Table 2: Coordinates of residences

Residence ID	Coordinates (GDA 94 MGA Zone 54)	
	Easting	Northing
Associated Residences		
J17aa	235026.4	5817386
L17aa	237170	5817965
L17ab	237848	5817275
K31aa	236084	5831076
K31ab	236079	5831300
J31aa	235760	5831259
H20aa	233938	5820296
<i>Rented</i>		
N31ac	239898.7	5831041
Residences		
N31ab	239974	5831555
M29aa	238304	5829565
K34aa	236976.3	5834575
H18aa	233207.2	5818510
N31aa	239978.7	5831899
N32aa	239833.1	5832255
N32ab	239817	5832604
N32ac	239814.2	5832666
K15aa	236990	5815534
N33aa	239620	5833196
P30aa	241058.8	5830668
L28aa	237842.2	5828237
N33ab	239458.4	5833703
G16aa	232610	5816865
M18ae	238478	5818196
K35aa	236864.4	5835269
P30ad	241164.8	5830144
L27aa	238045.6	5827952
M18ab	238255	5818880
P31aa	241199.9	5831198
G17aa	232345.3	5817030
I19aa	234649.2	5819546
M16aa	238711	5816662
L19ab	237955	5819290
P31ad	241340.5	5831005

Residence ID	Coordinates (GDA 94 MGA Zone 54)	
	Easting	Northing
M15ab	238167.1	5815748
I30aa	234369.9	5830429
M19aa	238258.1	5819036
M18ac	238563.7	5818677
M28ab	238839	5828082
M28ac	238695.6	5828012
N34ab	239883.4	5834034
P29aa	241408.3	5829909
P30ac	241508.6	5830462
H13aa	233813	5813799
J14aa	235220.9	5814079
I30ab	234180.6	5830398
J27aa	235616.8	5827287
M27aa	238703	5827889
M35aa	238580.4	5835430
N34aa	239792	5834345
L35aa	237163.8	5835779
N28ab	239097.9	5828072
M15aa	238188.8	5815465
N28aa	239302.9	5828034
P31ab	241306.4	5831925
P32ac	241262.9	5832122
M27ab	238599.1	5827680
L15ab	238005.1	5815238
N27ac	239176.1	5827983
I34ab	234242.8	5834747
J27ac	235447	5827175
N27aa	239690.3	5827927
G17ab	231912	5817260
H29am	233914.5	5829643
L15aa	237984.8	5815127
P32ab	241324.6	5832300
I19ab	234381	5819964
N27ab	239427.2	5827791
H29af	233913.4	5829172
P32aa	241365.4	5832402

Residence ID	Coordinates (GDA 94 MGA Zone 54)	
	Easting	Northing
M18aa	238991	5818801
M27ac	238215.1	5827144
H29an	233715.2	5829429
H30aj	233680.7	5830381
J35ab	235107.8	5835652
J13aa	235860	5813836
N16aa	239228	5816486
J35ac	235030.7	5835652
H30aa	233592.4	5830921
I34aa	234434.7	5835000
I35aa	234913.6	5835651
J35aa	235110.5	5835776
H30ab	233531.4	5830941
H29al	233567.3	5829612
H32ab	233671	5832873
M36aa	238306.6	5836114
J36ab	235983.5	5836166
L36aa	237769.7	5836240
M14at	238252.3	5814930
O34aa	240172	5834871
L36ab	237563.9	5836300
L36ac	237539.5	5836311
H29aj	233459.2	5829807
H29ak	233468.5	5829691
H30ac	233451.6	5830958
H30ad	233422	5830922
H30ai	233426.5	5830360
L14aa	237310	5814264
J26ae	235463.2	5826697
I27af	234434.9	5827307
M14ar	238296	5814855
P31ac	241554	5831622
I35ab	234611.7	5835622
K13aa	236685	5813872
L26aa	237935.4	5826662
M36ab	238459.8	5836223
M36ac	238812.1	5836105

Residence ID	Coordinates (GDA 94 MGA Zone 54)	
	Easting	Northing
J26ad	235384.6	5826639
J36ac	235435.9	5836142
M14ac	238232	5814722
M14ad	238317.6	5814804
M36ad	238797.7	5836127
L36ae	237510.9	5836472
N35ab	239292	5835907
I27ad	234362.5	5827196
I27ag	234238.7	5827357
L20aa	237780	5820400
L36ad	237379.4	5836503
M19ab	238798	5819663
N35aa	239277.2	5836002
N35ae	239675.2	5835709
L20ac	237936.9	5820346
I35ac	234281.2	5835490
J26af	235218.9	5826618
L36ag	237356.7	5836562
H33ab	233337.8	5833421
N15af	239378	5815872
I27ae	234162	5827265
J36aa	235873.2	5836468
L26ad	237528.5	5826302
M20ab	238366	5820167
I26aa	234665.1	5826747
O35aa	240436.7	5835222
H29ab	233080.5	5829583
H29ad	233076.8	5829668
H29ai	233164	5829118
I26ab	234511.1	5826717
H29aa	233054.4	5829373
J26ac	235365.5	5826279
L26ah	237045	5826077
I26ah	234300.8	5826908
K26aa	236957.9	5825970
K26ab	236724.4	5826007
K26ac	236503.8	5826014

Residence ID	Coordinates (GDA 94 MGA Zone 54)	
	Easting	Northing
K25ac	236534.9	5825960
<i>Unoccupied</i>		
I34ac	234532	5834258
N16ab	239115	5816724
N35ah	239675.9	5835116
M14aa	238224	5814793
M14ae	238340	5814775
O35ag	240160	5835262
M14af	238337	5814709
M14ag	238360	5814694
M14au	238398	5814727
M14aq	238493.7	5814752
K25ae	236450.7	5825946
I34ac	234532	5834258
<i>Unknown</i>		
J17ab	235914.1	5817261
Unnamed House 1	239833.7	5832362
L18aa	237913	5818705
I14aa	234313.3	5814053
G17ac	232414.4	5817058
G17ad	232418	5817031
M15ad	238159	5815955
N34ac	239763.2	5833769
M19ae	238418.3	5818896
I28aa	234788	5827918
H14aa	232224	5814915
I34ad	234425.8	5834954
H30al	233716	5830656
M36af	238209.7	5836023
J36ad	236280.4	5836157
Unnamed House 2	235062.2	5827020

Residence ID	Coordinates (GDA 94 MGA Zone 54)	
	Easting	Northing
L36af	237809.6	5836231
N15ah	239080.7	5815898
M15ac	238970.7	5815742
M14ba	238373.8	5815007
M14as	238273.5	5814898
H30ak	233418.5	5830219
H30am	233400.7	5830328
Unnamed House 3	238839.1	5836073
Unnamed House 4	234160.3	5827493
M20aa	238027	5820287
M14az	238260.1	5814597
H29ac	233199	5829657
M14ah	238355	5814674
Unnamed House 5	234399.5	5827110
J26aa	235788.3	5826368
L20ab	237875	5820448
N15af	238875.8	5815169
Unnamed House 6	235786.7	5826361
H29ae	233088.9	5829861
N15ad	239200	5815479
Unnamed House 7	237515	5826262
L20ad	237785.6	5820610
M20am	238009.8	5820533
M20an	238062.7	5820515
I27ah	235953.7	5826108
Unnamed House 8	237099.8	5826067
Unnamed House 9	237041.3	5825994
Unnamed House 10	238884.3	5826477
Unnamed House 11	236510.5	5826020
Unnamed House 12	236523.6	5826016

3 RELEVANT NOISE LIMITS

The Permit details the relevant noise limits as follows:

NOISE LIMITS

22. Construction of the wind energy facility must comply with noise criteria specified in the EPA *Noise Control Guidelines, Construction and Demolition Site Noise*, Publication 1254, October 2008 at any dwelling existing on land in the vicinity of the proposed wind energy facility as at the date of the issue of this permit to the satisfaction of the Minister for Planning.

23. Except as provided below in this condition, the operation of the wind energy facility must comply with New Zealand Standard 6808:2010, Acoustics – Wind Farm Noise (the Standard) as modified by this condition to the satisfaction of the Minister for Planning.

In determining compliance the following requirements apply:

- a) The operator must ensure that at any wind speed, wind farm sound levels, determined in accordance with the Standard at noise sensitive locations (as defined in the Standard) do not exceed a noise limit of 40dB LA90,10min or background (LA90,10min) plus 5dB, whichever is greater.
- b) Compliance must be assessed separately for all-time and night time. For the purpose of this requirement, night time is defined as 10.00pm to 7.00am, and
- c) Where special audible characteristics, including tonality, impulsive sound or excessive amplitude modulation occur, the measured noise level with the identified special audible characteristics will be modified by applying a penalty of up to + 6 dB L90 in accordance with section 5.4 of the Standard.

Any dwelling on the subject land may be exempt from this condition. This exemption will be given effect through an agreement with the landowner and must be registered on title, unless varied through the written consent of the Minister for Planning. Such dwellings will be known as host dwellings.

4 NOISE PREDICTION MODELS

4.1 Warranted Sound Power Levels

The final turbine selection is the Vestas 3.8MW wind turbine with a hub height of 93m above ground level and serrated blades. The overall average (L_{eq}) sound power levels and one-third octave band spectra are provided in the Vestas document: *V136-3.8 MW Third Octave Noise Emission "DMS 0071-6683_V02"*. The levels in this document have been used to predict the noise using the ISO9613.2 model with NZS6808:2010 inputs. However, as the planning permit is based on the L_{90} descriptor rather than the L_{eq} descriptor, an adjustment has been made for use in other models. In order to predict the L_{90} noise level from the wind farm, the Sound Power levels in the document have been adjusted by subtracting 2 dB(A) to convert the average (L_{eq}) levels to L_{90} levels in accordance with IOA recommendations.

Appendix B summarises the data used for the turbines in their normal operating mode as both the average (L_{eq}) levels and L_{90} levels.

4.2 ISO 9613.2 Noise Prediction Model Using IOA Inputs

Noise predictions were conducted in accordance with the propagation model, ISO 9613-2:1996 "Acoustics – Attenuation of sound during propagation outdoors" (ISO 9613). ISO 9613 is known as a downwind model, which means that its assessment approach enables the conservative assumption of a receiver being downwind of all noise sources (that is, the wind being in multiple directions from each turbine to the receiver, even when turbines are on the opposite side of a receiver). The model inputs have been taken from the May 2013 UK IOA Good Practice Guide, including:

- Warranted L_{90} sound power level data provided by Vestas;
- 10°C temperature;
- 70% relative humidity;
- 50% acoustically hard ground and 50% acoustically soft ground;
- barrier attenuation of no greater than 2 dB(A);
- 4m receiver height; and,
- Application of a 3 dB(A) correction where a "concave" ground profile exists as defined by the Institute of Acoustics¹.

¹ Institute of Acoustics, "A Good Practice Guide to the Application of ETSU-R-97 for the Assessment and Rating of Wind Turbine Noise", May 2013

4.3 ISO 9613.2 Noise Prediction Model Using NZS6808:2010 Inputs

Noise predictions have also been conducted using ISO 9613-2:1996, using inputs described in NZS6808:2010. The method states that the *predicted time-average (LEQ) wind farm sound levels occurring at receiver locations shall be taken as the predicted L90 wind farm sound level* and therefore the average L_{eq} sound power levels has been used for this method. The model has been based on the following inputs;

- Warranted L_{eq} sound power level data provided by Vestas;
- 10°C temperature;
- 70% relative humidity;
- 50% acoustically hard ground and 50% acoustically soft ground; and,
- 1.5m receiver height.

4.4 Predicted Wind Turbine Operational Noise

The predicted noise levels at the residences in the vicinity of the wind farm are presented as an L_{90} for the IOA Good Practice Guide based noise model and an L_{eq} for the NZS6808:2010 based noise model in Appendix C.

It is noted that no allowance (increase or decrease in noise prediction) has been made for the wake turbulence from a turbine on a downwind turbine. This is because having a turbine upwind tends to reduce the wind speed at downwind turbines and therefore also reduces the noise level. Cooper and Evans² conducted noise measurements of a turbine which was influenced by the wake of an upwind turbine. The paper concluded, "the data gathered as part of this assessment does not support the proposition that the wakes of adjacent turbines will increase the level of noise emissions from wind farms".

The tables in Appendix C demonstrate that the predicted noise level is no greater than 40 dB(A) using the ISO9613.2 noise model with IOA inputs as well as with NZS6808:2010 inputs. These predicted noise levels comply with the requirements of the Permit.

² Cooper J and Evans T, "Influence of upwind turbines on wind turbine sound power output", Australian Acoustical Society Proceedings of Acoustics 2012

5 VESTAS CURTAILMENT STRATEGY

Notwithstanding the predicted compliance using the IOA and NZS6808:2010 prediction methodologies, Vestas devised a curtailment strategy to further reduce noise from the wind farm. The curtailment strategy has recently been revised. The curtailment strategy involves operating selected turbines in a noise reduced mode at the wind speeds and wind directions with the highest predicted noise levels.

The noise propagation in the various wind directions has been determined based on measured propagation in different directions³ for the four noise reduced modes summarised in Appendix B, and the following Vestas Documents:

- Project-Specific Performance Specification for “Lal Lal” V136-3.80 MW 50/60 Hz (Low HH), “0067-3747 V04”
- V136-3.45 MW Third octave noise emission “DMS 0055-9919_V04”

The revised Vestas Strategies are summarised in Tables 3 and 4 below:

Table 3: Vestas Curtailment Strategy 24 hour criteria

WTG	Start Mitigation Wind Direction	End Mitigation Wind Direction	3	4	5	6	7	8	9	10	11	12	13
YSWT02	110	270							SO4	SO1			
YSWT03	110	270							SO3				
YSWT05	110	270							SO3				
YSWT06	110	270							SO2				
YSWT18	160	300							SO3				
YSWT25	210	20							SO3	SO3			
YSWT27	210	20							SO3	SO3			
YSWT30	210	20							SO3				
YSWT31	210	20							SO3				
YSWT32	160	300						SO3	SO4	SO3			
YSWT33	210	20						SO3	SO4	SO3			
YSWT34	210	20						SO3	SO4	SO3			
YSWT35	210	20							SO4	SO3			
YSWT36	160	300						SO3	SO4	SO3			
YSWT38	200	100							SO2	SO2			
YSWT39	160	300							SO3	SO2			
YSWT40	330	100							SO3				

³ Evans T and Cooper J, “Influence of wind direction on noise emission and propagation from wind turbines” Proceedings of Acoustics 2012 - Fremantle

Table 4: Vestas Curtailment Strategy Night time criteria

WTG	Start Mitigation Wind Direction	End Mitigation Wind Direction	3	4	5	6	7	8	9	10	11	12	13
ESWT01	80	180							SO3				
ESWT02	80	180							SO1				
YSWT02	110	270							SO4	SO4	SO1		
YSWT03	110	270							SO3	SO3			
YSWT05	110	270							SO3	SO3			
YSWT06	110	270							SO2	SO2	SO2		
YSWT18	160	300							SO3	SO3	SO3		
YSWT25	210	20							SO3	SO3	SO3		
YSWT27	210	20							SO3	SO3	SO3		
YSWT30	210	20							SO3	SO3	SO3		
YSWT31	210	20							SO3	SO3	SO3		
YSWT32	160	300						SO3	SO4	SO4	SO4		
YSWT33	210	20						SO3	SO4	SO4	SO4		
YSWT34	210	20						SO3	SO4	SO4	SO4		
YSWT35	210	20							SO4	SO4	SO4		
YSWT36	160	300						SO3	SO4	SO3	SO3		
YSWT38	200	100							SO2	SO2	SO2		
YSWT39	160	300							SO3	SO3	SO3		
YSWT40	330	100							SO3	SO3	SO3		

The noise at residences in the vicinity, with the revised Vestas curtailment strategy operating, has been predicted using noise models described in Section 4 as well as an additional 'hard ground' noise model. The hard ground model is a conservative model that has been included at the request of residents in the vicinity. It is not considered to accurately model the noise from a wind farm. The inputs to each noise model and the predicted noise levels are summarised below.

5.1 ISO9613.2 Noise Propagation Model with IOA inputs

Noise Model Inputs

The inputs for the ISO9613.2 noise propagation model and IOA inputs are in accordance with Section 4 of this report.

Predicted Noise Levels

Based on the revised Vestas curtailment strategy, the highest predicted noise level for any wind direction is summarised in the tables below:

Table 5: Predicted noise levels for Vestas Strategy using ISO9613.2 with IOA Inputs for 24 Hour Criteria

Name	Associated	Predicted Noise Level (dB(A)) for integer Hub Height Wind Speeds (m/s)										
		3	4	5	6	7	8	9	10	11	12	13
N31ab	No											
Criteria		40	40	40	40	40	40	40	41	43	45	47
Prediction							38	39	39	41	41	41
M29aa	No											
Criteria		40	40	40	40	40	40	40	41	43	45	47
Prediction							39	39	39			
K34aa	No											
Criteria		40	40	40	40	40	40	40	42	44	47	49
Prediction								39	41			
N31aa	No											
Criteria		40	40	40	40	40	40	40	40	40	40	40
Prediction							37	38	38	40	40	40
N32aa	No											
Criteria		40	40	40	40	40	40	40	40	40	40	40
Prediction							37	37	38	39	39	39

Table 6: Predicted noise levels for Vestas Strategy using ISO9613.2 with IOA Inputs for Night Time Criteria

Name	Associated	Predicted Noise Level (dB(A)) for integer Hub Height Wind Speeds (m/s)										
		3	4	5	6	7	8	9	10	11	12	13
N31ab	No											
Criteria		40	40	40	40	40	40	40	40	40	43	45
Prediction							38	39	39	39	41	41
M29aa	No											
Criteria		40	40	40	40	40	40	40	40	40	43	45
Prediction							39	39	39	39		
K34aa	No											
Criteria		40	40	40	40	40	40	40	40	42	45	48
Prediction								39	39	41		
H18aa	No											
Criteria		40	40	40	40	40	40	40	43	47	50	53
Prediction								40				
N31aa	No											
Criteria		40	40	40	40	40	40	40	40	40	40	40
Prediction							37	38	38	38	40	40
N32aa	No											
Criteria		40	40	40	40	40	40	40	40	40	40	40
Prediction							37	37	38	38	39	39

5.2 ISO9613.2 Noise Propagation Model with New Zealand Standard Inputs

The inputs for the ISO9613.2 noise propagation model and NZS inputs are in accordance with section 4 of this report.

Predicted Noise Levels

Based on the revised Vestas curtailment strategy, the highest predicted noise level for any wind direction is summarised in the tables below:

Table 7: Predicted noise levels for Vestas Strategy using ISO9613.2 with NZS Inputs for 24 Hour Criteria

Name	Associated	Predicted Noise Level (dB(A)) for integer Hub Height Wind Speeds (m/s)										
		3	4	5	6	7	8	9	10	11	12	13
N31ab	No											
Criteria		40	40	40	40	40	40	40	41	43	45	47
Prediction							38	39	39	41	41	41
M29aa	No											
Criteria		40	40	40	40	40	40	40	41	43	45	47
Prediction							38	38	38			
K34aa	No											
Criteria		40	40	40	40	40	40	40	42	44	47	49
Prediction								39	41			
N31aa	No											
Criteria		40	40	40	40	40	40	40	40	40	40	40
Prediction							37	38	38	40	40	40
N32aa	No											
Criteria		40	40	40	40	40	40	40	40	40	40	40
Prediction							37	37	38	39	39	39

Table 8: Predicted noise levels for Vestas Strategy using ISO9613.2 with NZS Inputs for Night Time Criteria

Name	Associated	Predicted Noise Level (dB(A)) for integer Hub Height Wind Speeds (m/s)										
		3	4	5	6	7	8	9	10	11	12	13
N31ab	No											
Criteria		40	40	40	40	40	40	40	40	40	43	45
Prediction							38	39	39	39	41	41
M29aa	No											
Criteria		40	40	40	40	40	40	40	40	40	43	45
Prediction							38	38	38	38		
K34aa	No											
Criteria		40	40	40	40	40	40	40	40	42	45	48
Prediction								39	39	41		
H18aa	No											
Criteria		40	40	40	40	40	40	40	43	47	50	53
Prediction								40				
N31aa	No											
Criteria		40	40	40	40	40	40	40	40	40	40	40
Prediction							37	38	38	38	40	40
N32aa	No											
Criteria		40	40	40	40	40	40	40	40	40	40	40
Prediction							37	37	38	38	39	39

5.3 ISO9613.2 Noise Propagation Model with Hard Ground

Noise Model Inputs

An ISO9613.2 model has also been developed which uses acoustically hard ground. For the alternate model, the receiver height is reduced to 1.5m above ground level. All other model inputs are in accordance with the IOA Good Practice Guide.

Predicted Noise Levels

Based on the revised Vestas curtailment strategy, the highest predicted noise level for any wind direction is summarised in the tables below:

Table 9: Predicted noise levels for Vestas Strategy using ISO9613.2 with Hard Ground for 24 Hour Criteria

Name	Associated	Predicted Noise Level (dB(A)) for integer Hub Height Wind Speeds (m/s)										
		3	4	5	6	7	8	9	10	11	12	13
N31ab	No											
Criteria		40	40	40	40	40	40	40	41	43	45	47
Prediction							40	41	41	43	43	43
M29aa	No											
Criteria		40	40	40	40	40	40	40	41	43	45	47
Prediction							41	41	41			
K34aa	No											
Criteria		40	40	40	40	40	40	40	42	44	47	49
Prediction								41	43			
N31aa	No											
Criteria		40	40	40	40	40	40	40	40	40	40	40
Prediction							39	40	40	42	42	42
N32aa	No											
Criteria		40	40	40	40	40	40	40	40	40	40	40
Prediction							39	39	40	41	41	41


Table 10: Predicted noise levels for Vestas Strategy using ISO9613.2 with Hard Ground for Night Time

Criteria

Name	Associated	Predicted Noise Level (dB(A)) for integer Hub Height Wind Speeds (m/s)										
		3	4	5	6	7	8	9	10	11	12	13
N31ab	No											
Criteria		40	40	40	40	40	40	40	40	40	43	45
Prediction							40	41	41	41	43	43
M29aa	No											
Criteria		40	40	40	40	40	40	40	40	40	43	45
Prediction							41	41	41	41		
K34aa	No											
Criteria		40	40	40	40	40	40	40	40	42	45	48
Prediction								41	41	43		
H18aa	No											
Criteria		40	40	40	40	40	40	40	43	47	50	53
Prediction								42				
N31aa	No											
Criteria		40	40	40	40	40	40	40	40	40	40	40
Prediction							39	40	40	40	42	42
N32aa	No											
Criteria		40	40	40	40	40	40	40	40	40	40	40
Prediction							39	39	40	40	41	41

Based on the above tables, the revised Vestas curtailment strategy is predicted to achieve the noise criteria for the IOA and NZS6808:2010 models but exceeds the criteria by up to 2 dB(A) for the more conservative hard ground model. Notwithstanding the predictions, the noise will be required to achieve the criteria and adjustments to the curtailment strategy will be made if the criteria are not achieved.

APPENDIX A: Lal Lal Wind Farm General Layout

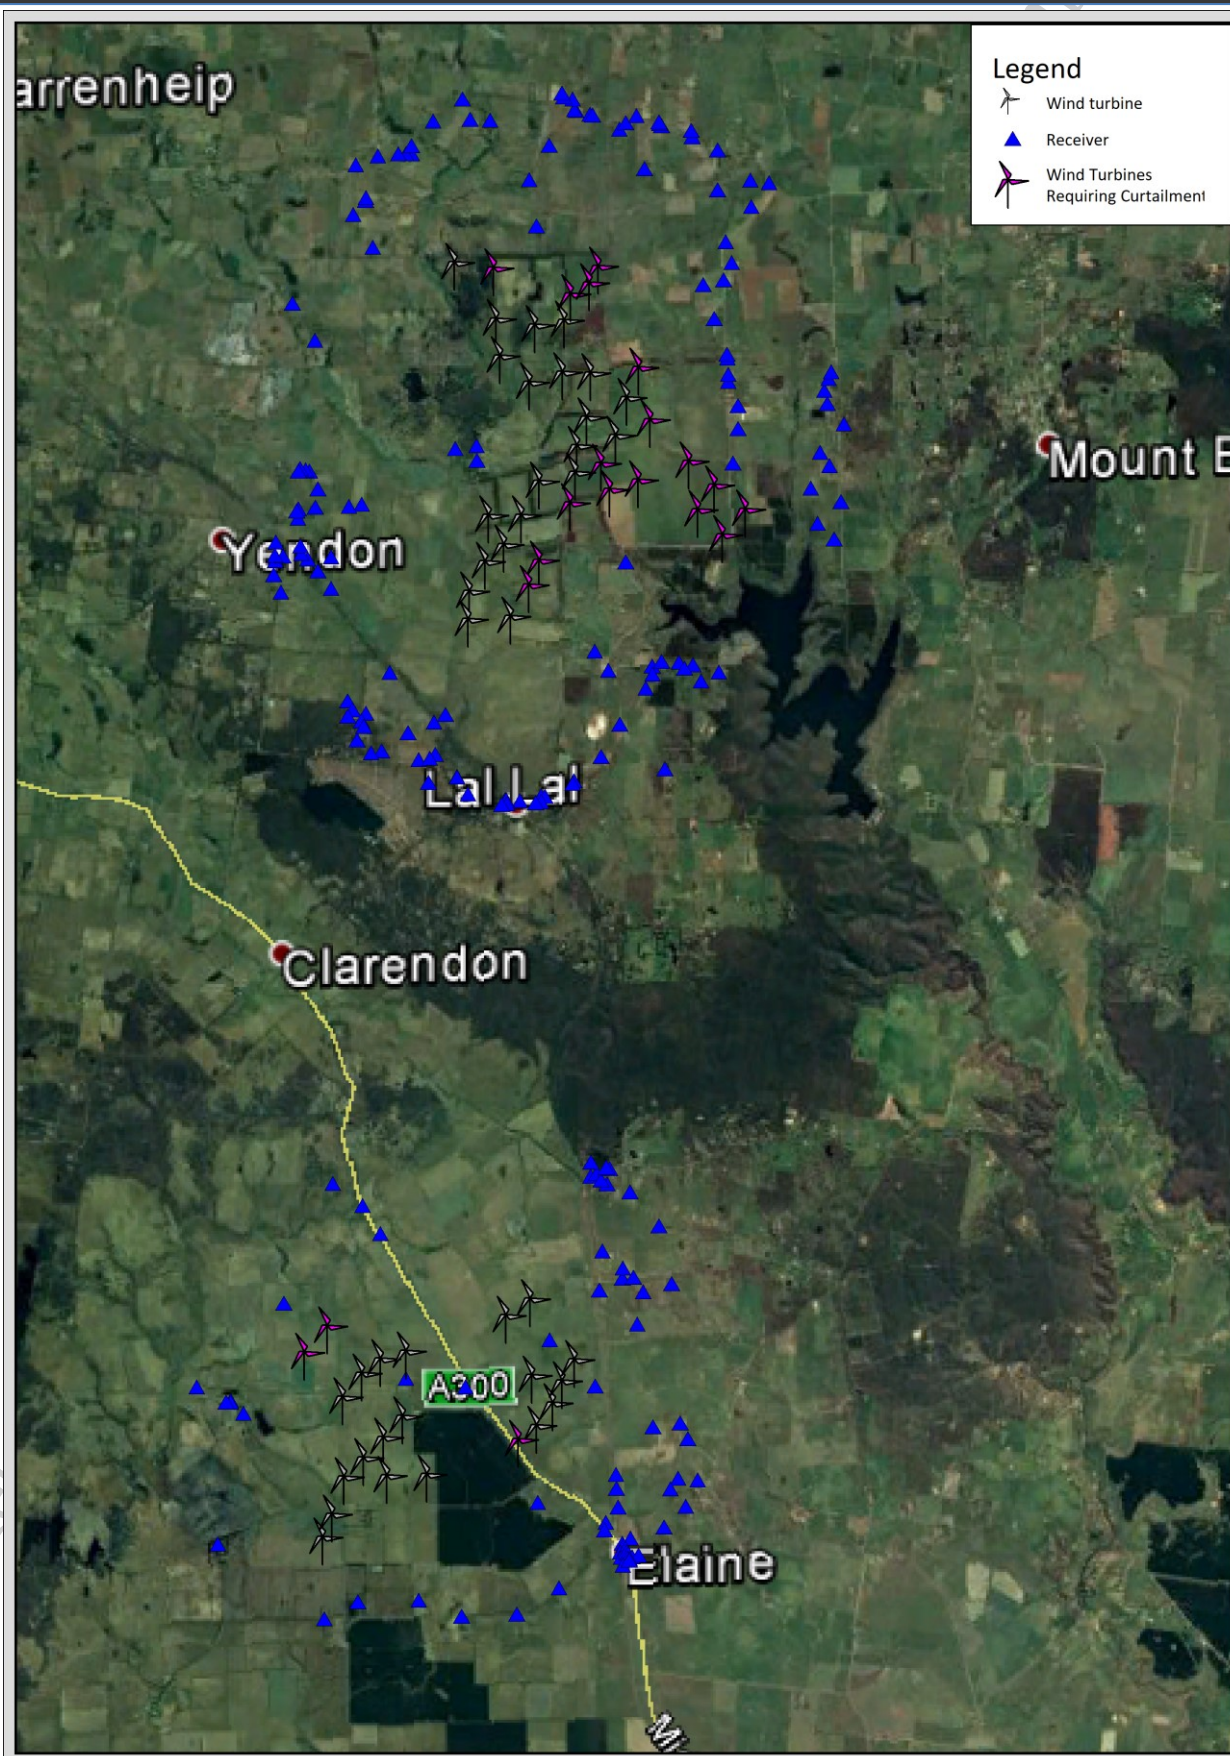

APPENDIX B: Vestas Sound Power Level Data

1/3 Octave Band Sound Power Levels for Vestas 3.8MW turbine (dB(A)) normal operating mode - L_{eq}

Hub Height Wind Speed	1/3 Octave Band Centre Frequency																												Overall
	20	25	31.5	40	50	63	80	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150	4000	5000	6300	8000	10000	
3 m/s	47.2	51.8	56.3	60.5	64.1	67.5	70.6	73.3	75.6	77.7	79.3	80.6	81.7	82.3	82.7	82.6	82.3	81.6	80.6	79.1	77.4	75.4	73	70.1	67.1	63.7	59.8	55.8	92.2
4 m/s	46.6	51.3	55.9	60.2	64	67.5	70.7	73.4	75.8	78	79.7	81	82	82.7	83	83	82.6	81.9	80.8	79.3	77.5	75.4	72.9	70	66.8	63.3	59.2	55.1	92.5
5 m/s	48.4	53.2	57.8	62.2	65.9	69.5	72.7	75.4	77.8	80	81.7	83	84.1	84.8	85.1	85	84.6	83.8	82.8	81.2	79.4	77.3	74.7	71.7	68.6	65	60.9	56.7	94.5
6 m/s	51.7	56.5	61	65.3	69	72.5	75.8	78.4	80.8	83	84.6	86	87	87.6	87.9	87.9	87.5	86.7	85.6	84.1	82.3	80.2	77.7	74.7	71.6	68	63.9	59.7	97.4
7 m/s	55.1	59.8	64.3	68.6	72.3	75.8	79	81.6	83.9	86.1	87.8	89.1	90.1	90.7	91	91	90.5	89.8	88.7	87.2	85.4	83.3	80.8	77.8	74.7	71.1	67	62.9	100.5
8 m/s	58.4	63.1	67.5	71.8	75.4	78.8	82	84.6	86.9	89.1	90.7	92	93	93.6	93.9	93.8	93.4	92.7	91.6	90.1	88.3	86.2	83.7	80.8	77.7	74.2	70.2	66.1	103.4
9 m/s	60.8	65.4	69.8	74	77.6	81	84.1	86.7	89	91.1	92.7	94	95	95.6	95.9	95.8	95.4	94.7	93.6	92.1	90.4	88.3	85.8	82.9	79.9	76.4	72.4	68.4	105.4
10 m/s	61.2	65.7	70.1	74.3	77.8	81.2	84.3	86.9	89.1	91.2	92.8	94.1	95	95.7	96	95.9	95.5	94.8	93.7	92.2	90.5	88.5	86	83.2	80.1	76.7	72.8	68.7	105.5
11 m/s	61.5	66	70.3	74.5	78	81.3	84.4	86.9	89.1	91.2	92.8	94.1	95	95.7	95.9	95.9	95.5	94.8	93.7	92.2	90.6	88.6	86.2	83.3	80.3	76.9	73	69.1	105.5
12 m/s	62	66.5	70.7	74.8	78.2	81.5	84.5	87	89.2	91.3	92.8	94	95	95.6	95.9	95.8	95.4	94.8	93.8	92.3	90.7	88.7	86.4	83.6	80.7	77.3	73.5	69.6	105.5
13 m/s	62.4	66.8	71	75	78.4	81.6	84.6	87	89.2	91.3	92.8	94	94.9	95.6	95.9	95.8	95.4	94.8	93.8	92.3	90.7	88.8	86.5	83.7	80.9	77.6	73.8	70	105.5

1/3 Octave Band Sound Power Levels for Vestas 3.8MW turbine (dB(A)) normal operating mode - L_{90}

Hub Height Wind Speed	1/3 Octave Band Centre Frequency																												Overall
	20	25	31.5	40	50	63	80	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150	4000	5000	6300	8000	10000	
3 m/s	45.2	49.8	54.3	58.5	62.1	65.5	68.6	71.3	73.6	75.7	77.3	78.6	79.7	80.3	80.7	80.6	80.3	79.6	78.6	77.1	75.4	73.4	71	68.1	65.1	61.7	57.8	53.8	90.2
4 m/s	44.6	49.3	53.9	58.2	62	65.5	68.7	71.4	73.8	76	77.7	79	80	80.7	81	81	80.6	79.9	78.8	77.3	75.5	73.4	70.9	68	64.8	61.3	57.2	53.1	90.5
5 m/s	46.4	51.2	55.8	60.2	63.9	67.5	70.7	73.4	75.8	78	79.7	81	82.1	82.8	83.1	83	82.6	81.8	80.8	79.2	77.4	75.3	72.7	69.7	66.6	63	58.9	54.7	92.5
6 m/s	49.7	54.5	59	63.3	67	70.5	73.8	76.4	78.8	81	82.6	84	85	85.6	85.9	85.9	85.5	84.7	83.6	82.1	80.3	78.2	75.7	72.7	69.6	66	61.9	57.7	95.4
7 m/s	53.1	57.8	62.3	66.6	70.3	73.8	77	79.6	81.9	84.1	85.8	87.1	88.1	88.7	89	89	88.5	87.8	86.7	85.2	83.4	81.3	78.8	75.8	72.7	69.1	65	60.9	98.5
8 m/s	56.4	61.1	65.5	69.8	73.4	76.8	80	82.6	84.9	87.1	88.7	90	91	91.6	91.9	91.8	91.4	90.7	89.6	88.1	86.3	84.2	81.7	78.8	75.7	72.2	68.2	64.1	101.4
9 m/s	58.8	63.4	67.8	72	75.6	79	82.1	84.7	87	89.1	90.7	92	93	93.6	93.9	93.8	93.4	92.7	91.6	90.1	88.4	86.3	83.8	80.9	77.9	74.4	70.4	66.4	103.4
10 m/s	59.2	63.7	68.1	72.3	75.8	79.2	82.3	84.9	87.1	89.2	90.8	92.1	93	93.7	94	93.9	93.5	92.8	91.7	90.2	88.5	86.5	84	81.2	78.1	74.7	70.8	66.7	103.5
11 m/s	59.5	64	68.3	72.5	76	79.3	82.4	84.9	87.1	89.2	90.8	92.1	93	93.7	93.9	93.9	93.5	92.8	91.7	90.2	88.6	86.6	84.2	81.3	78.3	74.9	71	67.1	103.5
12 m/s	60	64.5	68.7	72.8	76.2	79.5	82.5	85	87.2	89.3	90.8	92	93	93.6	93.9	93.8	93.4	92.8	91.8	90.3	88.7	86.7	84.4	81.6	78.7	75.3	71.5	67.6	103.5
13 m/s	60.4	64.8	69	73	76.4	79.6	82.6	85	87.2	89.3	90.8	92	92.9	93.6	93.9	93.8	93.4	92.8	91.8	90.3	88.7	86.8	84.5	81.7	78.9	75.6	71.8	68	103.5

1/3 Octave Band Sound Power Levels for Vestas 3.8MW turbine (dB(A)) noise reduced power mode (S01) - L_{eq}

Hub Height Wind Speed	1/3 Octave Band Centre Frequency																												Overall
	20	25	31.5	40	50	63	80	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150	4000	5000	6300	8000	10000	
3 m/s	47.9	55	58.4	60.6	66	74.4	76.2	75.3	81.2	77.3	77.4	81.5	84	75.8	76.1	79	78.7	84.8	80.6	79.6	78.5	76.5	74.5	72.9	64.3	62.5	61.7	58.5	92.2
4 m/s	47.6	54.5	57.4	61	66.2	74	77.1	75.2	80.1	78.8	78.3	80.8	83.5	77.1	77.3	79.4	79.9	84.9	81.8	80.7	79.3	77.4	75.1	72.8	64.4	61.3	61	59.4	92.5
5 m/s	49.8	56.6	59.1	63.5	68.3	74.9	78.6	77	80.5	81.3	80.7	82.5	84.5	80.3	80.5	81.8	82.2	86.2	84.2	83.2	81.8	80.1	77.4	74.5	66.7	61.8	60	58.4	94.4
6 m/s	53.4	59.9	62.5	67	71.6	76.8	80.5	79.8	82.3	83.9	83.8	85.5	86.7	84.2	84.6	85.3	85.5	88.5	87.5	86.6	85.3	83.7	80.8	77.3	70.2	64.1	60.2	57.8	97.4
7 m/s	56.7	62.9	65.5	70.3	74.6	78.7	82.4	82.5	84	86.5	86.8	88.2	88.6	87.8	88.6	88.7	88.9	90.8	90.9	90.1	88.7	87.2	84.2	80.1	73.5	66.2	60.4	57.4	100.4
8 m/s	60	65.9	68.8	73.3	77.6	80.6	84.1	85.1	85.9	88.6	89.5	91	90.8	90.9	92	91.8	91.8	93.1	93.8	93	91.7	90.3	87.2	82.8	76.6	68.7	61	57.1	103.2
9 m/s	61.3	67.1	70	74.6	78.8	81.5	85	86.1	86.7	89.6	90.7	92.1	91.7	92.3	93.4	93.1	93.1	94	95	94.3	93	91.6	88.5	83.9	77.9	69.7	61.4	57.2	104.4
10 m/s	61.4	67.2	70.1	74.6	78.8	81.5	84.9	86.2	86.8	89.6	90.7	92.2	91.7	92.2	93.4	93.2	93.1	94	95	94.3	93	91.6	88.5	83.9	78	69.8	61.4	57.1	104.4
11 m/s	61.9	67.7	70.9	74.8	79.1	81.8	84.7	86.5	87.4	89.1	90.6	92.7	92.1	92	93.3	93.3	92.9	94.3	94.7	94.2	93	91.6	88.6	84.3	78.3	70.7	61.7	56.7	104.4
12 m/s	62.2	68	71.4	74.9	79.2	82	84.5	86.6	87.8	88.8	90.5	93.1	92.4	91.9	93.1	93.4	92.7	94.4	94.5	94	93	91.6	88.6	84.5	78.5	71.2	61.8	56.3	104.4
13 m/s	62.4	68.2	71.7	74.9	79.3	82.1	84.4	86.7	87.9	88.6	90.5	93.2	92.5	91.8	93.1	93.5	92.6	94.4	94.4	94	93	91.5	88.6	84.6	78.6	71.5	61.8	56.1	104.4

1/3 Octave Band Sound Power Levels for Vestas 3.8MW turbine (dB(A)) noise reduced power mode (S01) - L₉₀

Hub Height Wind Speed	1/3 Octave Band Centre Frequency																												Overall
	20	25	31.5	40	50	63	80	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150	4000	5000	6300	8000	10000	
3 m/s	45.9	53.0	56.4	58.6	64.0	72.4	74.2	73.3	79.2	75.3	75.4	79.5	82.0	73.8	74.1	77.0	76.7	82.8	78.6	77.6	76.5	74.5	72.5	70.9	62.3	60.5	59.7	56.5	90.2
4 m/s	45.6	52.5	55.4	59.0	64.2	72.0	75.1	73.2	78.1	76.8	76.3	78.8	81.5	75.1	75.3	77.4	77.9	82.9	79.8	78.7	77.3	75.4	73.1	70.8	62.4	59.3	59.0	57.4	90.5
5 m/s	47.8	54.6	57.1	61.5	66.3	72.9	76.6	75.0	78.5	79.3	78.7	80.5	82.5	78.3	78.5	79.8	80.2	84.2	82.2	81.2	79.8	78.1	75.4	72.5	64.7	59.8	58.0	56.4	92.4
6 m/s	51.4	57.9	60.5	65.0	69.6	74.8	78.5	77.8	80.3	81.9	81.8	83.5	84.7	82.2	82.6	83.3	83.5	86.5	85.5	84.6	83.3	81.7	78.8	75.3	68.2	62.1	58.2	55.8	95.4
7 m/s	54.7	60.9	63.5	68.3	72.6	76.7	80.4	80.5	82.0	84.5	84.8	86.2	86.6	85.8	86.6	86.7	86.9	88.8	88.9	88.1	86.7	85.2	82.2	78.1	71.5	64.2	58.4	55.4	98.4
8 m/s	58.0	63.9	66.8	71.3	75.6	78.6	82.1	83.1	83.9	86.6	87.5	89.0	88.8	88.9	90.0	89.8	89.8	91.1	91.8	91.0	89.7	88.3	85.2	80.8	74.6	66.7	59.0	55.1	101.2
9 m/s	59.3	65.1	68.0	72.6	76.8	79.5	83.0	84.1	84.7	87.6	88.7	90.1	89.7	90.3	91.4	91.1	91.1	92.0	93.0	92.3	91.0	89.6	86.5	81.9	75.9	67.7	59.4	55.2	102.4
10 m/s	59.4	65.2	68.1	72.6	76.8	79.5	82.9	84.2	84.8	87.6	88.7	90.2	89.7	90.2	91.4	91.2	91.1	92.0	93.0	92.3	91.0	89.6	86.5	81.9	76.0	67.8	59.4	55.1	102.4
11 m/s	59.9	65.7	68.9	72.8	77.1	79.8	82.7	84.5	85.4	87.1	88.6	90.7	90.1	90.0	91.3	91.3	90.9	92.3	92.7	92.2	91.0	89.6	86.6	82.3	76.3	68.7	59.7	54.7	102.4
12 m/s	60.2	66.0	69.4	72.9	77.2	80.0	82.5	84.6	85.8	86.8	88.5	91.1	90.4	89.9	91.1	91.4	90.7	92.4	92.5	92.0	91.0	89.6	86.6	82.5	76.5	69.2	59.8	54.3	102.4
13 m/s	60.4	66.2	69.7	72.9	77.3	80.1	82.4	84.7	85.9	86.6	88.5	91.2	90.5	89.8	91.1	91.5	90.6	92.4	92.4	92.0	91.0	89.5	86.6	82.6	76.6	69.5	59.8	54.1	102.4

1/3 Octave Band Sound Power Levels for Vestas 3.8MW turbine (dB(A)) noise reduced power mode (S02) - L_{eq}

Hub Height Wind Speed	1/3 Octave Band Centre Frequency																												Overall
	20	25	31.5	40	50	63	80	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150	4000	5000	6300	8000	10000	
3 m/s	47.9	55	58.4	60.6	66	74.4	76.2	75.3	81.2	77.3	77.4	81.5	84	75.8	76.1	79	78.7	84.8	80.6	79.6	78.5	76.5	74.5	72.9	64.3	62.5	61.7	58.5	92.2
4 m/s	47.6	54.5	57.4	61	66.2	74	77.1	75.2	80.1	78.8	78.3	80.8	83.5	77.1	77.3	79.4	79.9	84.9	81.8	80.7	79.3	77.4	75.1	72.8	64.4	61.3	61	59.4	92.5
5 m/s	49.8	56.6	59.1	63.5	68.3	74.9	78.6	77	80.5	81.3	80.7	82.5	84.5	80.3	80.5	81.8	82.2	86.2	84.2	83.2	81.8	80.1	77.4	74.5	66.7	61.8	60	58.4	94.4
6 m/s	53.4	59.9	62.5	67	71.6	76.8	80.5	79.8	82.3	83.9	83.8	85.5	86.7	84.2	84.6	85.3	85.5	88.5	87.5	86.6	85.3	83.7	80.8	77.3	70.2	64.1	60.2	57.8	97.4
7 m/s	56.7	62.9	65.5	70.3	74.6	78.7	82.4	82.5	84	86.5	86.8	88.2	88.6	87.8	88.6	88.7	88.9	90.8	90.9	90.1	88.7	87.2	84.2	80.1	73.5	66.2	60.4	57.4	100.4
8 m/s	59.7	65.7	68.5	73.1	77.4	80.5	84.1	84.9	85.8	88.5	89.3	90.8	90.7	90.7	91.7	91.6	91.6	92.9	93.6	92.8	91.5	90.1	87	82.6	76.4	68.6	61.1	57.3	103
9 m/s	60.1	66	68.7	73.5	77.8	80.7	84.4	85.2	85.9	89.1	89.9	91	90.8	91.4	92.4	92.1	92.3	93.2	94.2	93.4	92	90.6	87.5	82.9	76.8	68.6	61	57.4	103.5
10 m/s	60.3	66.2	69.1	73.6	77.9	80.8	84.3	85.3	86.1	88.9	89.8	91.2	91	91.3	92.4	92.1	92.2	93.3	94.1	93.4	92	90.6	87.5	83	76.9	68.9	61.1	57.2	103.5
11 m/s	60.9	66.7	69.9	73.8	78.1	81.1	84	85.6	86.6	88.4	89.7	91.8	91.3	91.1	92.2	92.3	91.9	93.5	93.8	93.2	92	90.6	87.6	83.4	77.3	69.8	61.2	56.5	103.5
12 m/s	61.2	67.1	70.4	73.9	78.3	81.3	83.8	85.8	87	88	89.6	92.2	91.6	90.9	92.2	92.5	91.8	93.6	93.6	93.1	92	90.6	87.7	83.6	77.5	70.4	61.3	55.9	103.5
13 m/s	61.4	67.3	70.7	74	78.4	81.3	83.6	85.9	87.2	87.8	89.6	92.3	91.7	90.9	92.1	92.5	91.7	93.6	93.5	93.1	92	90.6	87.7	83.7	77.6	70.6	61.2	55.6	103.5

1/3 Octave Band Sound Power Levels for Vestas 3.8MW turbine (dB(A)) noise reduced power mode (S02) - L₉₀

Hub Height Wind Speed	1/3 Octave Band Centre Frequency																												Overall
	20	25	31.5	40	50	63	80	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150	4000	5000	6300	8000	10000	
3 m/s	45.9	53.0	56.4	58.6	64.0	72.4	74.2	73.3	79.2	75.3	75.4	79.5	82.0	73.8	74.1	77.0	76.7	82.8	78.6	77.6	76.5	74.5	72.5	70.9	62.3	60.5	59.7	56.5	90.2
4 m/s	45.6	52.5	55.4	59.0	64.2	72.0	75.1	73.2	78.1	76.8	76.3	78.8	81.5	75.1	75.3	77.4	77.9	82.9	79.8	78.7	77.3	75.4	73.1	70.8	62.4	59.3	59.0	57.4	90.5
5 m/s	47.8	54.6	57.1	61.5	66.3	72.9	76.6	75.0	78.5	79.3	78.7	80.5	82.5	78.3	78.5	79.8	80.2	84.2	82.2	81.2	79.8	78.1	75.4	72.5	64.7	59.8	58.0	56.4	92.4
6 m/s	51.4	57.9	60.5	65.0	69.6	74.8	78.5	77.8	80.3	81.9	81.8	83.5	84.7	82.2	82.6	83.3	83.5	86.5	85.5	84.6	83.3	81.7	78.8	75.3	68.2	62.1	58.2	55.8	95.4
7 m/s	54.7	60.9	63.5	68.3	72.6	76.7	80.4	80.5	82.0	84.5	84.8	86.2	86.6	85.8	86.6	86.7	86.9	88.8	88.9	88.1	86.7	85.2	82.2	78.1	71.5	64.2	58.4	55.4	98.4
8 m/s	57.7	63.7	66.5	71.1	75.4	78.5	82.1	82.9	83.8	86.5	87.3	88.8	88.7	88.7	89.7	89.6	89.6	90.9	91.6	90.8	89.5	88.1	85.0	80.6	74.4	66.6	59.1	55.3	101.0
9 m/s	58.1	64.0	66.7	71.5	75.8	78.7	82.4	83.2	83.9	87.1	87.9	89.0	88.8	89.4	90.4	90.1	90.3	91.2	92.2	91.4	90.0	88.6	85.5	80.9	74.8	66.6	59.0	55.4	101.5
10 m/s	58.3	64.2	67.1	71.6	75.9	78.8	82.3	83.3	84.1	86.9	87.8	89.2	89.0	89.3	90.4	90.1	90.2	91.3	92.1	91.4	90.0	88.6	85.5	81.0	74.9	66.9	59.1	55.2	101.5
11 m/s	58.9	64.7	67.9	71.8	76.1	79.1	82.0	83.6	84.6	86.4	87.7	89.8	89.3	89.1	90.2	90.3	89.9	91.5	91.8	91.2	90.0	88.6	85.6	81.4	75.3	67.8	59.2	54.5	101.5
12 m/s	59.2	65.1	68.4	71.9	76.3	79.3	81.8	83.8	85.0	86.0	87.6	90.2	89.6	88.9	90.2	90.5	89.8	91.6	91.6	91.1	90.0	88.6	85.7	81.6	75.5	68.4	59.3	53.9	101.5
13 m/s	59.4	65.3	68.7	72.0	76.4	79.3	81.6	83.9	85.2	85.8	87.6	90.3	89.7	88.9	90.1	90.5	89.7	91.6	91.5	91.1	90.0	88.6	85.7	81.7	75.6	68.6	59.2	53.6	101.5

1/3 Octave Band Sound Power Levels for Vestas 3.8MW turbine (dB(A)) noise reduced power mode (S03) - L_{eq}

Hub Height Wind Speed	1/3 Octave Band Centre Frequency																												Overall
	20	25	31.5	40	50	63	80	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150	4000	5000	6300	8000	10000	
3 m/s	47.9	55	58.4	60.6	66	74.4	76.2	75.3	81.2	77.3	77.4	81.5	84	75.8	76.1	79	78.7	84.8	80.6	79.6	78.5	76.5	74.5	72.9	64.3	62.5	61.7	58.5	92.2
4 m/s	47.6	54.5	57.4	61	66.2	74	77.1	75.2	80.1	78.8	78.3	80.8	83.5	77.1	77.3	79.4	79.9	84.9	81.8	80.7	79.3	77.4	75.1	72.8	64.4	61.3	61	59.4	92.5
5 m/s	49.8	56.6	59.1	63.5	68.3	74.9	78.6	77	80.5	81.3	80.7	82.5	84.5	80.3	80.5	81.8	82.2	86.2	84.2	83.2	81.8	80.1	77.4	74.5	66.7	61.8	60	58.4	94.4
6 m/s	53.4	59.9	62.5	67	71.6	76.8	80.5	79.8	82.3	83.9	83.8	85.5	86.7	84.2	84.6	85.3	85.5	88.5	87.5	86.6	85.3	83.7	80.8	77.3	70.2	64.1	60.2	57.8	97.4
7 m/s	56.7	62.9	65.5	70.3	74.6	78.7	82.4	82.5	84	86.5	86.8	88.2	88.6	87.8	88.6	88.7	88.9	90.8	90.9	90.1	88.7	87.2	84.2	80.1	73.5	66.2	60.4	57.4	100.4
8 m/s	58.4	64.4	67	72	76.3	79.6	83.6	83.8	84.8	88.1	88.5	89.5	89.7	89.9	90.8	90.5	90.8	92	92.8	92	90.5	89.1	86	81.5	75.2	67.2	60.6	57.5	102.1
9 m/s	57.8	63.9	66.4	71.6	75.8	79.2	83.4	83.4	84.2	88	88.3	89	89.2	89.6	90.5	90.1	90.6	91.6	92.6	91.7	90.2	88.8	85.6	81	74.7	66.5	60.2	57.5	101.8
10 m/s	58	64.1	66.9	71.3	75.6	79.3	82.7	83.3	84.7	86.8	87.5	89.3	89.4	88.6	89.6	89.7	89.6	91.5	91.6	90.9	89.6	88.1	85.1	81	74.6	67.3	60.4	56.7	101.2
11 m/s	57.9	64.1	67.1	70.9	75.4	79.3	82.2	83.2	84.9	86.1	87.1	89.3	89.4	88	88.9	89.4	89	91.3	90.9	90.3	89.1	87.6	84.7	80.9	74.4	67.6	60.5	56.2	100.8
12 m/s	57.8	63.9	67	70.6	75.1	79.1	81.7	82.9	84.8	85.5	86.6	89.1	89.2	87.5	88.4	89	88.5	91	90.3	89.8	88.7	87.2	84.3	80.6	74.1	67.6	60.3	55.8	100.4
13 m/s	57.7	63.8	67	70.4	75	79	81.5	82.8	84.8	85.2	86.4	89.1	89.1	87.2	88.1	88.9	88.2	90.9	90	89.5	88.4	86.9	84.1	80.5	74	67.6	60.3	55.6	100.2

1/3 Octave Band Sound Power Levels for Vestas 3.8MW turbine (dB(A)) noise reduced power mode (S03) - L₉₀

Hub Height Wind Speed	1/3 Octave Band Centre Frequency																												Overall
	20	25	31.5	40	50	63	80	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150	4000	5000	6300	8000	10000	
3 m/s	45.9	53.0	56.4	58.6	64.0	72.4	74.2	73.3	79.2	75.3	75.4	79.5	82.0	73.8	74.1	77.0	76.7	82.8	78.6	77.6	76.5	74.5	72.5	70.9	62.3	60.5	59.7	56.5	90.2
4 m/s	45.6	52.5	55.4	59.0	64.2	72.0	75.1	73.2	78.1	76.8	76.3	78.8	81.5	75.1	75.3	77.4	77.9	82.9	79.8	78.7	77.3	75.4	73.1	70.8	62.4	59.3	59.0	57.4	90.5
5 m/s	47.8	54.6	57.1	61.5	66.3	72.9	76.6	75.0	78.5	79.3	78.7	80.5	82.5	78.3	78.5	79.8	80.2	84.2	82.2	81.2	79.8	78.1	75.4	72.5	64.7	59.8	58.0	56.4	92.4
6 m/s	51.4	57.9	60.5	65.0	69.6	74.8	78.5	77.8	80.3	81.9	81.8	83.5	84.7	82.2	82.6	83.3	83.5	86.5	85.5	84.6	83.3	81.7	78.8	75.3	68.2	62.1	58.2	55.8	95.4
7 m/s	54.7	60.9	63.5	68.3	72.6	76.7	80.4	80.5	82.0	84.5	84.8	86.2	86.6	85.8	86.6	86.7	86.9	88.8	88.9	88.1	86.7	85.2	82.2	78.1	71.5	64.2	58.4	55.4	98.4
8 m/s	56.4	62.4	65.0	70.0	74.3	77.6	81.6	81.8	82.8	86.1	86.5	87.5	87.7	87.9	88.8	88.5	88.8	90.0	90.8	90.0	88.5	87.1	84.0	79.5	73.2	65.2	58.6	55.5	100.1
9 m/s	55.8	61.9	64.4	69.6	73.8	77.2	81.4	81.4	82.2	86.0	86.3	87.0	87.2	87.6	88.5	88.1	88.6	89.6	90.6	89.7	88.2	86.8	83.6	79.0	72.7	64.5	58.2	55.5	99.8
10 m/s	56.0	62.1	64.9	69.3	73.6	77.3	80.7	81.3	82.7	84.8	85.5	87.3	87.4	86.6	87.6	87.7	87.6	89.5	89.6	88.9	87.6	86.1	83.1	79.0	72.6	65.3	58.4	54.7	99.2
11 m/s	55.9	62.1	65.1	68.9	73.4	77.3	80.2	81.2	82.9	84.1	85.1	87.3	87.4	86.0	86.9	87.4	87.0	89.3	88.9	88.3	87.1	85.6	82.7	78.9	72.4	65.6	58.5	54.2	98.8
12 m/s	55.8	61.9	65.0	68.6	73.1	77.1	79.7	80.9	82.8	83.5	84.6	87.1	87.2	85.5	86.4	87.0	86.5	89.0	88.3	87.8	86.7	85.2	82.3	78.6	72.1	65.6	58.3	53.8	98.4
13 m/s	55.7	61.8	65.0	68.4	73.0	77.0	79.5	80.8	82.8	83.2	84.4	87.1	87.1	85.2	86.1	86.9	86.2	88.9	88.0	87.5	86.4	84.9	82.1	78.5	72.0	65.6	58.3	53.6	98.2

1/3 Octave Band Sound Power Levels for Vestas 3.8MW turbine (dB(A)) noise reduced power mode (S04) - L_{eq}

Hub Height Wind Speed	1/3 Octave Band Centre Frequency																												Overall
	20	25	31.5	40	50	63	80	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150	4000	5000	6300	8000	10000	
3 m/s	47.9	55	58.4	60.6	66	74.4	76.2	75.3	81.2	77.3	77.4	81.5	84	75.8	76.1	79	78.7	84.8	80.6	79.6	78.5	76.5	74.5	72.9	64.3	62.5	61.7	58.5	92.2
4 m/s	47.6	54.5	57.4	61	66.2	74	77.1	75.2	80.1	78.8	78.3	80.8	83.5	77.1	77.3	79.4	79.9	84.9	81.8	80.7	79.3	77.4	75.1	72.8	64.4	61.3	61	59.4	92.5
5 m/s	49.8	56.6	59.1	63.5	68.3	74.9	78.6	77	80.5	81.3	80.7	82.5	84.5	80.3	80.5	81.8	82.2	86.2	84.2	83.2	81.8	80.1	77.4	74.5	66.7	61.8	60	58.4	94.4
6 m/s	53.3	59.8	62.4	66.9	71.5	76.7	80.4	79.7	82.2	83.8	83.7	85.4	86.6	84.1	84.5	85.2	85.4	88.4	87.4	86.5	85.2	83.6	80.7	77.2	70.1	64	60.1	57.7	97.3
7 m/s	54.9	61.3	64.3	67.8	72.5	77.7	80.4	80.8	83.7	83.5	84	86.9	87.7	84.3	84.9	86.1	85.5	89.2	87.4	86.8	85.7	84.1	81.4	78.4	71.2	65.9	60.7	56.9	97.9
8 m/s	55.2	61.6	64.9	67.8	72.6	78.1	80.2	81	84.2	83.1	83.9	87.3	88	84	84.6	86.1	85.2	89.4	87	86.6	85.6	84	81.4	78.6	71.4	66.6	61.1	56.7	97.9
9 m/s	55.4	61.9	65.3	67.8	72.7	78.3	80.1	81.1	84.6	82.8	83.8	87.6	88.3	83.7	84.4	86.1	85	89.5	86.8	86.4	85.5	83.8	81.3	78.8	71.5	67.1	61.4	56.6	97.9
10 m/s	55.5	62	65.4	67.8	72.7	78.3	80	81.2	84.8	82.7	83.7	87.6	88.4	83.7	84.3	86.1	84.9	89.5	86.7	86.3	85.4	83.8	81.3	78.8	71.5	67.2	61.5	56.6	97.9
11 m/s	55.5	62	65.4	67.8	72.7	78.4	80	81.2	84.8	82.6	83.7	87.7	88.4	83.7	84.3	86.1	84.9	89.6	86.7	86.3	85.4	83.8	81.3	78.8	71.5	67.3	61.5	56.6	97.9
12 m/s	55.6	62.1	65.6	67.8	72.7	78.5	79.9	81.3	85	82.5	83.7	87.8	88.5	83.5	84.2	86.1	84.8	89.6	86.5	86.2	85.4	83.7	81.3	78.9	71.6	67.5	61.7	56.5	97.9
13 m/s	55.6	62	65.5	67.8	72.7	78.4	80	81.2	84.9	82.6	83.7	87.7	88.4	83.6	84.2	86.1	84.9	89.6	86.6	86.3	85.4	83.8	81.3	78.8	71.6	67.4	61.6	56.5	97.9

1/3 Octave Band Sound Power Levels for Vestas 3.8MW turbine (dB(A)) noise reduced power mode (S04) - L₉₀

Hub Height Wind Speed	1/3 Octave Band Centre Frequency																											Overall	
	20	25	31.5	40	50	63	80	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150	4000	5000	6300	8000		10000
3 m/s	45.9	53.0	56.4	58.6	64.0	72.4	74.2	73.3	79.2	75.3	75.4	79.5	82.0	73.8	74.1	77.0	76.7	82.8	78.6	77.6	76.5	74.5	72.5	70.9	62.3	60.5	59.7	56.5	90.2
4 m/s	45.6	52.5	55.4	59.0	64.2	72.0	75.1	73.2	78.1	76.8	76.3	78.8	81.5	75.1	75.3	77.4	77.9	82.9	79.8	78.7	77.3	75.4	73.1	70.8	62.4	59.3	59.0	57.4	90.5
5 m/s	47.8	54.6	57.1	61.5	66.3	72.9	76.6	75.0	78.5	79.3	78.7	80.5	82.5	78.3	78.5	79.8	80.2	84.2	82.2	81.2	79.8	78.1	75.4	72.5	64.7	59.8	58.0	56.4	92.4
6 m/s	51.3	57.8	60.4	64.9	69.5	74.7	78.4	77.7	80.2	81.8	81.7	83.4	84.6	82.1	82.5	83.2	83.4	86.4	85.4	84.5	83.2	81.6	78.7	75.2	68.1	62.0	58.1	55.7	95.3
7 m/s	52.9	59.3	62.3	65.8	70.5	75.7	78.4	78.8	81.7	81.5	82.0	84.9	85.7	82.3	82.9	84.1	83.5	87.2	85.4	84.8	83.7	82.1	79.4	76.4	69.2	63.9	58.7	54.9	95.9
8 m/s	53.2	59.6	62.9	65.8	70.6	76.1	78.2	79.0	82.2	81.1	81.9	85.3	86.0	82.0	82.6	84.1	83.2	87.4	85.0	84.6	83.6	82.0	79.4	76.6	69.4	64.6	59.1	54.7	95.9
9 m/s	53.4	59.9	63.3	65.8	70.7	76.3	78.1	79.1	82.6	80.8	81.8	85.6	86.3	81.7	82.4	84.1	83.0	87.5	84.8	84.4	83.5	81.8	79.3	76.8	69.5	65.1	59.4	54.6	95.9
10 m/s	53.5	60.0	63.4	65.8	70.7	76.3	78.0	79.2	82.8	80.7	81.7	85.6	86.4	81.7	82.3	84.1	82.9	87.5	84.7	84.3	83.4	81.8	79.3	76.8	69.5	65.2	59.5	54.6	95.9
11 m/s	53.5	60.0	63.4	65.8	70.7	76.4	78.0	79.2	82.8	80.6	81.7	85.7	86.4	81.7	82.3	84.1	82.9	87.6	84.7	84.3	83.4	81.8	79.3	76.8	69.5	65.3	59.5	54.6	95.9
12 m/s	53.6	60.1	63.6	65.8	70.7	76.5	77.9	79.3	83.0	80.5	81.7	85.8	86.5	81.5	82.2	84.1	82.8	87.6	84.5	84.2	83.4	81.7	79.3	76.9	69.6	65.5	59.7	54.5	95.9
13 m/s	53.6	60.0	63.5	65.8	70.7	76.4	78.0	79.2	82.9	80.6	81.7	85.7	86.4	81.6	82.2	84.1	82.9	87.6	84.6	84.3	83.4	81.8	79.3	76.8	69.6	65.4	59.6	54.5	95.9

APPENDIX C: Predicted Noise Levels

L₉₀ Predicted noise levels from wind turbine operation - IOA Good Practice Guide Model.

Name	Associated	Predicted Noise Level (dB(A)) for integer Hub Height Wind Speeds (m/s)										
		3	4	5	6	7	8	9	10	11	12	13
J17aa	Yes	32	32	34	37	40	43	45	45	45	45	45
L17aa	Yes	31	31	33	36	39	42	44	44	44	44	44
N31ac	Yes	31	31	33	36	39	42	44	44	44	44	44
L17ab	Yes	30	30	32	35	38	41	43	43	43	43	43
K31aa	Yes	28	28	30	33	36	39	41	41	41	41	41
J17ab	Yes	27	28	30	33	36	39	41	41	41	41	41
K31ab	Yes	27	27	29	32	35	38	40	40	40	40	40
N31ab	No	27	27	29	32	35	38	40	40	40	40	40
M29aa	No	26	27	29	32	35	38	40	40	40	40	40
K34aa	No	26	27	29	31	35	37	39	40	40	40	40
H18aa	No	26	26	28	31	34	37	39	39	39	39	39
J31aa	Yes	26	26	28	31	34	37	39	39	39	39	39
N31aa	No	25	25	27	30	33	36	38	38	38	38	38
N32aa	No	25	25	27	30	33	36	38	38	38	38	38
Unnamed House 1	No	24	25	27	30	33	36	38	38	38	38	38
N32ab	No	24	24	26	29	32	35	37	37	37	37	37
L18aa	No	24	24	26	29	32	35	37	37	37	37	37
N32ac	No	24	24	26	29	32	35	37	37	37	37	37
K15aa	No	23	24	26	29	32	35	37	37	37	37	37
N33aa	No	23	23	25	28	31	34	36	36	36	36	36
P30aa	No	23	23	25	28	31	34	36	36	36	36	36
L28aa	No	23	23	25	28	31	34	36	36	36	36	36
N33ab	No	22	23	25	28	31	34	36	36	36	36	36
G16aa	No	22	23	25	28	31	34	36	36	36	36	36
M18ae	No	22	23	25	28	31	34	36	36	36	36	36
K35aa	No	22	22	24	27	30	33	35	35	35	35	35
P30ad	No	22	22	24	27	30	33	35	35	35	35	35
I14aa	No	21	22	24	27	30	33	35	35	35	35	35
G17ac	No	21	22	24	27	30	33	35	35	35	35	35
G17ad	No	21	22	24	27	30	33	35	35	35	35	35
M15ad	No	21	22	24	27	30	33	35	35	35	35	35
N34ac	No	21	21	23	26	29	32	34	34	34	34	34

Name	Associated	Predicted Noise Level (dB(A)) for integer Hub Height Wind Speeds (m/s)										
		3	4	5	6	7	8	9	10	11	12	13
L27aa	No	21	21	23	26	29	32	34	34	34	34	34
M18ab	No	21	21	23	26	29	32	34	34	34	34	34
P31aa	No	21	21	23	26	29	32	34	34	34	34	34
G17aa	No	21	21	23	26	29	32	34	34	34	34	34
I19aa	No	21	21	23	26	29	32	34	34	34	34	34
M16aa	No	21	21	23	26	29	32	34	34	34	34	34
L19ab	No	21	21	23	26	29	32	34	34	34	34	34
P31ad	No	21	21	23	26	29	32	34	34	34	34	34
M15ab	No	21	21	23	26	29	32	34	34	34	34	34
I30aa	No	20	21	23	26	29	32	34	34	34	34	34
M19aa	No	20	21	23	26	29	32	34	34	34	34	34
I34ac	No	20	21	23	26	29	32	34	34	34	34	34
M18ac	No	20	21	23	26	29	32	34	34	34	34	34
M19ae	No	20	21	23	25	29	32	34	34	34	34	34
M28ab	No	20	20	23	25	29	31	33	34	34	34	34
M28ac	No	20	20	22	25	29	31	33	34	34	34	34
N34ab	No	20	20	22	25	28	31	33	33	33	33	33
P29aa	No	20	20	22	25	28	31	33	33	33	33	33
P30ac	No	20	20	22	25	28	31	33	33	33	33	33
I28aa	No	20	20	22	25	28	31	33	33	33	33	33
H13aa	No	20	20	22	25	28	31	33	33	33	33	33
J14aa	No	20	20	22	25	28	31	33	33	33	33	33
I30ab	No	20	20	22	25	28	31	33	33	33	33	33
J27aa	No	20	20	22	25	28	31	33	33	33	33	33
M27aa	No	20	20	22	25	28	31	33	33	33	33	33
M35aa	No	20	20	22	25	28	31	33	33	33	33	33
N34aa	No	20	20	22	25	28	31	33	33	33	33	33
L35aa	No	19	20	22	25	28	31	33	33	33	33	33
N28ab	No	19	20	22	25	28	31	33	33	33	33	33
M15aa	No	19	20	22	25	28	31	33	33	33	33	33
N28aa	No	19	20	22	25	28	31	33	33	33	33	33
P31ab	No	19	20	22	25	28	31	33	33	33	33	33
P32ac	No	19	20	22	24	28	31	33	33	33	33	33
M27ab	No	19	19	21	24	27	30	32	33	33	33	33
L15ab	No	19	19	21	24	27	30	32	32	32	32	32
N27ac	No	19	19	21	24	27	30	32	32	32	32	32
I34ab	No	19	19	21	24	27	30	32	32	32	32	32

Name	Associated	Predicted Noise Level (dB(A)) for integer Hub Height Wind Speeds (m/s)										
		3	4	5	6	7	8	9	10	11	12	13
J27ac	No	19	19	21	24	27	30	32	32	32	32	32
N27aa	No	19	19	21	24	27	30	32	32	32	32	32
G17ab	No	19	19	21	24	27	30	32	32	32	32	32
H14aa	No	19	19	21	24	27	30	32	32	32	32	32
H29am	No	19	19	21	24	27	30	32	32	32	32	32
L15aa	No	19	19	21	24	27	30	32	32	32	32	32
N16ab	No	19	19	21	24	27	30	32	32	32	32	32
P32ab	No	19	19	21	24	27	30	32	32	32	32	32
I19ab	No	19	19	21	24	27	30	32	32	32	32	32
N27ab	No	19	19	21	24	27	30	32	32	32	32	32
H29af	No	19	19	21	24	27	30	32	32	32	32	32
P32aa	No	18	19	21	24	27	30	32	32	32	32	32
I34ad	No	18	19	21	24	27	30	32	32	32	32	32
H30al	No	18	18	20	23	26	29	31	31	31	31	31
M18aa	No	18	18	20	23	26	29	31	31	31	31	31
M27ac	No	18	18	20	23	26	29	31	31	31	31	31
N35ah	No	18	18	20	23	26	29	31	31	31	31	31
H29an	No	18	18	20	23	26	29	31	31	31	31	31
H30aj	No	18	18	20	23	26	29	31	31	31	31	31
J35ab	No	18	18	20	23	26	29	31	31	31	31	31
J13aa	No	18	18	20	23	26	29	31	31	31	31	31
N16aa	No	18	18	20	23	26	29	31	31	31	31	31
M36af	No	18	18	20	23	26	29	31	31	31	31	31
J35ac	No	18	18	20	23	26	29	31	31	31	31	31
J36ad	No	18	18	20	23	26	29	31	31	31	31	31
H30aa	No	18	18	20	23	26	29	31	31	31	31	31
I34aa	No	18	18	20	23	26	29	31	31	31	31	31
I35aa	No	17	18	20	23	26	29	31	31	31	31	31
J35aa	No	17	18	20	23	26	29	31	31	31	31	31
Unnamed House 2	No	18	18	20	23	26	29	31	31	31	31	31
H30ab	No	17	18	20	23	26	29	31	31	31	31	31
H29al	No	17	18	20	23	26	29	31	31	31	31	31
H32ab	No	17	18	20	23	26	29	31	31	31	31	31
M36aa	No	17	18	20	23	26	29	31	31	31	31	31
L36af	No	17	18	20	23	26	29	31	31	31	31	31
N15ah	No	17	18	20	23	26	29	31	31	31	31	31
J36ab	No	17	18	20	23	26	29	31	31	31	31	31

Name	Associated	Predicted Noise Level (dB(A)) for integer Hub Height Wind Speeds (m/s)										
		3	4	5	6	7	8	9	10	11	12	13
L36aa	No	17	18	20	23	26	29	31	31	31	31	31
M14at	No	17	18	20	23	26	29	31	31	31	31	31
M15ac	No	17	18	20	23	26	29	31	31	31	31	31
O34aa	No	17	18	20	23	26	29	31	31	31	31	31
M14ba	No	17	18	20	22	26	29	31	31	31	31	31
L36ab	No	17	18	20	23	26	29	31	31	31	31	31
L36ac	No	17	18	20	22	26	29	31	31	31	31	31
H20aa	Yes	17	17	19	22	26	28	30	31	31	31	31
H29aj	No	17	17	19	22	26	28	30	31	31	31	31
H29ak	No	17	17	19	22	26	28	30	31	31	31	31
H30ac	No	17	17	19	22	26	28	30	31	31	31	31
H30ad	No	17	17	19	22	25	28	30	31	31	31	31
H30ai	No	17	17	19	22	25	28	30	31	31	31	31
L14aa	No	17	17	19	22	25	28	30	31	31	31	31
M14as	No	17	17	19	22	26	28	30	31	31	31	31
H30ak	No	17	17	19	22	25	28	30	31	31	31	31
J26ae	No	17	17	19	22	25	28	30	30	30	30	30
H30am	No	17	17	19	22	25	28	30	30	30	30	30
I27af	No	17	17	19	22	25	28	30	30	30	30	30
M14aa	No	17	17	19	22	25	28	30	30	30	30	30
M14ar	No	17	17	19	22	25	28	30	30	30	30	30
P31ac	No	17	17	19	22	25	28	30	30	30	30	30
I35ab	No	17	17	19	22	25	28	30	30	30	30	30
K13aa	No	17	17	19	22	25	28	30	30	30	30	30
L26aa	No	17	17	19	22	25	28	30	30	30	30	30
M36ab	No	17	17	19	22	25	28	30	30	30	30	30
M36ac	No	17	17	19	22	25	28	30	30	30	30	30
Unnamed House 3	No	17	17	19	22	25	28	30	30	30	30	30
J26ad	No	17	17	19	22	25	28	30	30	30	30	30
J36ac	No	17	17	19	22	25	28	30	30	30	30	30
M14ac	No	17	17	19	22	25	28	30	30	30	30	30
M14ad	No	17	17	19	22	25	28	30	30	30	30	30
M36ad	No	17	17	19	22	25	28	30	30	30	30	30
L36ae	No	17	17	19	22	25	28	30	30	30	30	30
M14ae	No	17	17	19	22	25	28	30	30	30	30	30
N35ab	No	17	17	19	22	25	28	30	30	30	30	30
Unnamed House 4	No	17	17	19	22	25	28	30	30	30	30	30

Name	Associated	Predicted Noise Level (dB(A)) for integer Hub Height Wind Speeds (m/s)										
		3	4	5	6	7	8	9	10	11	12	13
I27ad	No	16	17	19	22	25	28	30	30	30	30	30
I27ag	No	17	17	19	22	25	28	30	30	30	30	30
L20aa	No	17	17	19	22	25	28	30	30	30	30	30
L36ad	No	17	17	19	22	25	28	30	30	30	30	30
O35ag	No	17	17	19	22	25	28	30	30	30	30	30
M14af	No	16	17	19	22	25	28	30	30	30	30	30
M19ab	No	16	17	19	22	25	28	30	30	30	30	30
M20aa	No	16	17	19	22	25	28	30	30	30	30	30
N35aa	No	16	17	19	22	25	28	30	30	30	30	30
N35ae	No	16	17	19	22	25	28	30	30	30	30	30
L20ac	No	16	17	19	22	25	28	30	30	30	30	30
M14az	No	16	17	19	22	25	28	30	30	30	30	30
H29ac	No	16	17	19	22	25	28	30	30	30	30	30
I35ac	No	16	17	19	22	25	28	30	30	30	30	30
J26af	No	16	17	19	22	25	28	30	30	30	30	30
M14ag	No	16	17	19	22	25	28	30	30	30	30	30
M14ah	No	16	17	19	22	25	28	30	30	30	30	30
M14au	No	16	17	19	22	25	28	30	30	30	30	30
L36ag	No	16	17	19	22	25	28	30	30	30	30	30
Unnamed House 5	No	16	17	19	22	25	28	30	30	30	30	30
H33ab	No	16	16	19	21	25	27	30	30	30	30	30
J26aa	No	16	17	19	22	25	28	30	30	30	30	30
L20ab	No	16	17	19	21	25	27	30	30	30	30	30
N15af	No	16	17	19	21	25	27	30	30	30	30	30
N15af	No	16	17	19	22	25	28	30	30	30	30	30
Unnamed House 6	No	16	17	19	21	25	28	30	30	30	30	30
I27ae	No	16	16	18	21	25	27	29	30	30	30	30
J36aa	No	16	16	18	21	25	27	29	30	30	30	30
L26ad	No	16	16	18	21	24	27	29	30	30	30	30
M14aq	No	16	16	19	21	25	27	29	30	30	30	30
M20ab	No	16	16	18	21	24	27	29	30	30	30	30
H29ae	No	16	16	18	21	24	27	29	29	29	29	29
I26aa	No	16	16	18	21	24	27	29	29	29	30	30
N15ad	No	16	16	18	21	24	27	29	29	29	29	29
O35aa	No	16	16	18	21	24	27	29	29	29	29	29
Unnamed House 7	No	16	16	18	21	24	27	29	29	29	29	29
H29ab	No	16	16	18	21	24	27	29	29	29	29	29

Name	Associated	Predicted Noise Level (dB(A)) for integer Hub Height Wind Speeds (m/s)										
		3	4	5	6	7	8	9	10	11	12	13
H29ad	No	16	16	18	21	24	27	29	29	29	29	29
H29ai	No	16	16	18	21	24	27	29	29	29	29	29
I26ab	No	16	16	18	21	24	27	29	29	29	29	29
L20ad	No	16	16	18	21	24	27	29	29	29	29	29
M20am	No	16	16	18	21	24	27	29	29	29	29	29
H29aa	No	16	16	18	21	24	27	29	29	29	29	29
M20an	No	16	16	18	21	24	27	29	29	29	29	29
J26ac	No	16	16	18	21	24	27	29	29	29	29	29
L26ah	No	16	16	18	21	24	27	29	29	29	29	29
I27ah	No	16	16	18	21	24	27	29	29	29	29	29
Unnamed House 8	No	16	16	18	21	24	27	29	29	29	29	29
Unnamed House 9	No	15	16	18	21	24	27	29	29	29	29	29
Unnamed House 10	No	15	16	18	21	24	27	29	29	29	29	29
I26ah	No	16	16	18	21	24	27	29	29	29	29	29
K26aa	No	16	16	18	21	24	27	29	29	29	29	29
K26ab	No	15	16	18	21	24	27	29	29	29	29	29
K26ac	No	15	16	18	21	24	27	29	29	29	29	29
Unnamed House 11	No	16	16	18	21	24	27	29	29	29	29	29
Unnamed House 12	No	16	16	18	21	24	27	29	29	29	29	29
K25ac	No	15	16	18	21	24	27	29	29	29	29	29
K25ae	No	15	16	18	21	24	27	29	29	29	29	29

L_{eq} Predicted noise levels from wind turbine operation - NZS6808:2010.

Name	Associated	Predicted Noise Level (dB(A)) for integer Hub Height Wind Speeds (m/s)										
		3	4	5	6	7	8	9	10	11	12	13
J17aa	Yes	32	33	35	38	41	44	46	46	46	46	46
L17aa	Yes	32	32	34	37	40	43	45	45	45	45	45
N31ac	Yes	31	32	34	36	40	42	44	45	45	45	45
L17ab	Yes	30	30	32	35	38	41	43	43	43	43	43
J17ab	Yes	28	28	30	33	36	39	41	41	41	41	41
N31ab	No	27	27	29	32	35	38	40	40	40	40	40
K34aa	No	26	26	29	31	35	37	39	40	40	40	40
H18aa	No	26	26	28	31	34	37	39	39	39	39	39
K31aa	Yes	26	26	28	31	34	37	39	39	39	39	39
K31ab	Yes	26	26	28	31	34	37	39	39	39	39	39
M29aa	No	26	26	28	31	34	37	39	39	39	39	39
J31aa	Yes	25	26	28	31	34	37	39	39	39	39	39
N31aa	No	25	25	27	30	33	36	38	38	38	38	38
N32aa	No	24	24	27	29	33	35	37	38	38	38	37
K15aa	No	23	24	26	29	32	35	37	37	37	37	37
L18aa	No	23	24	26	29	32	35	37	37	37	37	37
P30aa	No	23	23	25	28	31	34	36	36	36	36	36
Unnamed House 1	No	23	23	25	28	31	34	36	36	36	36	36
N33aa	No	23	23	25	28	31	34	36	36	36	36	36
L28aa	No	23	23	25	28	31	34	36	36	36	36	36
G16aa	No	23	23	25	28	31	34	36	36	36	36	36
N32ab	No	22	23	25	28	31	34	36	36	36	36	36
N33ab	No	22	23	25	28	31	34	36	36	36	36	36
M18ae	No	22	22	25	27	31	33	35	36	36	36	36
P30ad	No	22	22	24	27	30	33	35	35	35	35	35
N32ac	No	22	22	24	27	30	33	35	35	35	35	35
L14aa	No	22	22	24	27	30	33	35	35	35	35	35
M15ad	No	21	22	24	27	30	33	35	35	35	35	35
K35aa	No	21	22	24	27	30	33	35	35	35	35	35
P31aa	No	21	22	24	27	30	33	35	35	35	35	35
N34ac	No	21	21	24	26	30	33	35	35	35	35	35
G17ac	No	21	21	24	26	30	32	34	35	35	35	35
M18ab	No	21	21	23	26	29	32	34	34	34	34	34
L19ab	No	21	21	23	26	29	32	34	34	34	34	34

Name	Associated	Predicted Noise Level (dB(A)) for integer Hub Height Wind Speeds (m/s)										
		3	4	5	6	7	8	9	10	11	12	13
G17ad	No	21	21	23	26	29	32	34	34	34	34	34
L27aa	No	21	21	23	26	29	32	34	34	34	34	34
M19aa	No	21	21	23	26	29	32	34	34	34	34	34
I34ac	No	21	21	23	26	29	32	34	34	34	34	34
M15ab	No	20	21	23	26	29	32	34	34	34	34	34
G17aa	No	20	21	23	26	29	32	34	34	34	34	34
M16aa	No	20	20	23	25	29	31	33	34	34	34	34
P29aa	No	20	20	23	25	29	31	33	34	34	34	34
J14aa	No	20	20	22	25	28	31	33	33	33	33	33
M28ac	No	20	20	22	25	28	31	33	33	33	33	33
P31ad	No	20	20	22	25	28	31	33	33	33	33	33
I19aa	No	20	20	22	25	28	31	33	33	33	33	33
M28ab	No	20	20	22	25	28	31	33	33	33	33	33
H13aa	No	20	20	22	25	28	31	33	33	33	33	33
N34ab	No	20	20	22	25	28	31	33	33	33	33	33
M19ae	No	20	20	22	25	28	31	33	33	33	33	33
M15aa	No	19	20	22	24	28	31	33	33	33	33	33
N34aa	No	19	19	22	25	28	31	33	33	33	33	33
P30ac	No	19	19	22	25	28	31	33	33	33	33	33
J27aa	No	19	19	21	24	27	30	32	33	33	32	32
M27aa	No	19	19	21	24	27	30	32	33	33	33	33
M35aa	No	19	19	21	24	27	30	32	33	33	33	33
J27ac	No	19	19	21	24	27	30	32	32	32	32	32
L35aa	No	19	19	21	24	27	30	32	32	32	32	32
P32ab	No	19	19	21	24	27	30	32	32	32	32	32
N16ab	No	19	19	21	24	27	30	32	32	32	32	32
P32aa	No	19	19	21	24	27	30	32	32	32	32	32
P32ac	No	19	19	21	24	27	30	32	32	32	32	32
H14aa	No	19	19	21	24	27	30	32	32	32	32	32
N27ab	No	19	19	21	24	27	30	32	32	32	32	32
P31ab	No	18	19	21	24	27	30	32	32	32	32	32
L15ab	No	18	18	21	24	27	30	32	32	32	32	32
M27ab	No	18	18	21	23	27	30	32	32	32	32	32
M27ac	No	18	18	21	23	27	30	32	32	32	32	32
G17ab	No	18	19	21	24	27	30	32	32	32	32	32
H29af	No	18	18	20	23	27	29	31	32	32	32	32
L15aa	No	18	18	20	23	26	29	31	31	31	31	31

Name	Associated	Predicted Noise Level (dB(A)) for integer Hub Height Wind Speeds (m/s)										
		3	4	5	6	7	8	9	10	11	12	13
M18aa	No	18	18	20	23	26	29	31	31	31	31	31
I30aa	No	18	18	20	23	26	29	31	31	31	31	31
I34ab	No	18	18	20	23	26	29	31	31	31	31	31
N16aa	No	18	18	20	23	26	29	31	31	31	31	31
H29am	No	18	18	20	23	26	29	31	31	31	31	31
I19ab	No	18	18	20	23	26	29	31	31	31	31	31
Unnamed House 2	No	18	18	20	23	26	29	31	31	31	31	31
J13aa	No	18	18	20	23	26	29	31	31	31	31	31
H20aa	Yes	17	18	20	23	26	29	31	31	31	31	31
M18ac	No	18	17	20	23	26	29	31	31	31	31	31
M36af	No	17	18	20	23	26	29	31	31	31	31	31
H30aa	No	17	17	20	22	26	28	31	31	31	31	31
I27af	No	17	17	20	22	26	28	31	31	31	31	31
I35aa	No	17	17	19	22	26	28	30	31	31	31	31
J35ab	No	17	17	20	22	26	28	30	31	31	31	31
L26aa	No	17	17	19	22	25	28	30	31	31	31	31
N15ah	No	17	17	19	22	25	28	30	30	30	30	30
H30ab	No	17	17	19	22	25	28	30	30	30	30	30
H29an	No	17	17	19	22	25	28	30	30	30	30	30
J35ac	No	17	17	19	22	25	28	30	30	30	30	30
L14aa	No	17	17	19	22	25	28	30	30	30	30	30
Unnamed House 4	No	17	17	19	22	25	28	30	30	30	30	30
H29al	No	17	17	19	22	25	28	30	30	30	30	30
I27ag	No	17	17	19	22	25	28	30	30	30	30	30
J36ad	No	17	17	19	22	25	28	30	30	30	30	30
H29ak	No	17	17	19	22	25	28	30	30	30	30	30
L20aa	No	17	17	19	22	25	28	30	30	30	30	30
L36aa	No	17	17	19	22	25	28	30	30	30	30	30
M14at	No	17	17	19	22	25	28	30	30	30	30	30
L36af	No	17	17	19	22	25	28	30	30	30	30	30
M14ba	No	17	17	19	22	25	28	30	30	30	30	30
H32ab	No	17	17	19	22	25	28	30	30	30	30	30
I28aa	No	17	16	19	22	25	28	30	30	30	30	30
J26aa	No	16	17	19	22	25	28	30	30	30	30	30
J36ab	No	17	17	19	22	25	28	30	30	30	30	30
J36ac	No	16	17	19	22	25	28	30	30	30	30	30
L20ab	No	16	17	19	22	25	28	30	30	30	30	30

Name	Associated	Predicted Noise Level (dB(A)) for integer Hub Height Wind Speeds (m/s)										
		3	4	5	6	7	8	9	10	11	12	13
M14as	No	17	17	19	22	25	28	30	30	30	30	30
N35ah	No	17	17	19	22	25	28	30	30	30	30	30
Unnamed House 6	No	16	17	19	22	25	28	30	30	30	30	30
I27ae	No	16	17	19	22	25	28	30	30	30	30	30
M14ar	No	16	17	19	22	25	28	30	30	30	30	30
M36ab	No	16	17	19	22	25	28	30	30	30	30	30
I27ad	No	16	16	19	22	25	28	30	30	30	30	30
L26ad	No	16	17	19	22	25	28	30	30	30	30	30
L36ab	No	16	17	19	22	25	28	30	30	30	30	30
M14aa	No	16	17	19	22	25	28	30	30	30	30	30
M14ac	No	16	17	19	22	25	28	30	30	30	30	30
M19ab	No	16	17	19	22	25	28	30	30	30	30	30
N28aa	No	16	16	19	22	25	28	30	30	30	30	30
Unnamed House 3	No	16	16	19	22	25	28	30	30	30	30	30
H29aj	No	16	16	19	21	25	27	30	30	30	30	30
I30ab	No	16	16	19	22	25	28	30	30	30	30	30
L36ac	No	16	16	19	21	25	28	30	30	30	30	30
M14ad	No	16	16	19	21	25	27	30	30	30	30	30
M15ac	No	16	16	19	22	25	28	30	30	30	30	30
M36aa	No	16	16	19	21	25	28	30	30	30	30	30
N15af	No	16	16	19	21	25	28	30	30	30	30	30
N28ab	No	16	16	19	21	25	27	30	30	30	30	30
I26aa	No	16	16	18	21	25	27	29	30	30	30	30
J26af	No	16	16	18	21	25	27	29	30	30	30	30
J35aa	No	16	16	18	21	24	27	29	30	30	30	30
Unnamed House 7	No	16	16	18	21	24	27	29	30	30	30	30
Q34aa	No	16	16	18	21	24	27	29	29	29	29	29
M20an	No	16	16	18	21	24	27	29	29	29	29	29
L26ah	No	16	16	18	21	24	27	29	29	29	29	29
M14ae	No	16	16	18	21	24	27	29	29	29	29	29
N27ac	No	16	16	18	21	24	27	29	29	29	29	29
Unnamed House 8	No	16	16	18	21	24	27	29	29	29	29	29
J26ae	No	16	16	18	21	24	27	29	29	29	29	29
J36aa	No	16	16	18	21	24	27	29	29	29	29	29
L36ae	No	16	16	18	21	24	27	29	29	29	29	29
M20ab	No	16	16	18	21	24	27	29	29	29	29	29
I27ah	No	16	16	18	21	24	27	29	29	29	29	29

Name	Associated	Predicted Noise Level (dB(A)) for integer Hub Height Wind Speeds (m/s)										
		3	4	5	6	7	8	9	10	11	12	13
Unnamed House 9	No	16	16	18	21	24	27	29	29	29	29	29
Unnamed House 10	No	16	16	18	21	24	27	29	29	29	29	29
K26ab	No	16	16	18	21	24	27	29	29	29	29	29
K26ac	No	16	16	18	21	24	27	29	29	29	29	29
Unnamed House 11	No	16	16	18	21	24	27	29	29	29	29	29
Unnamed House 12	No	16	16	18	21	24	27	29	29	29	29	29
H30al	No	16	16	18	21	24	27	29	29	29	29	29
H33ab	No	16	16	18	21	24	27	29	29	29	29	29
J26ac	No	16	16	18	21	24	27	29	29	29	29	29
K25ac	No	16	16	18	21	24	27	29	29	29	29	29
K26aa	No	16	16	18	21	24	27	29	29	29	29	29
H29ai	No	16	16	18	21	24	27	29	29	29	29	29
I26ab	No	15	16	18	21	24	27	29	29	29	29	29
K25ae	No	16	16	18	21	24	27	29	29	29	29	29
M14au	No	16	16	18	21	24	27	29	29	29	29	29
M36ac	No	16	16	18	21	24	27	29	29	29	29	29
H29ab	No	15	16	18	21	24	27	29	29	29	29	29
M14aq	No	15	16	18	21	24	27	29	29	29	29	29
N15ad	No	15	16	18	21	24	27	29	29	29	29	29
P31ac	No	15	15	18	21	24	27	29	29	29	29	29
N15af	No	15	16	18	21	24	27	29	29	29	29	29
L36ag	No	15	16	18	21	24	27	29	29	29	29	29
H29aa	No	15	15	18	21	24	27	29	29	29	29	29
H29ad	No	15	15	18	21	24	27	29	29	29	29	29
H29ae	No	15	15	18	21	24	27	29	29	29	29	29
I26ah	No	15	15	18	21	24	27	29	29	29	29	29
M20aa	No	15	15	18	21	24	27	29	29	29	29	29
L20ac	No	15	15	18	21	24	27	29	29	29	29	29
L36ad	No	15	15	18	21	24	27	29	29	29	29	29
O35aa	No	15	15	18	20	24	27	29	29	29	29	29
M36ad	No	15	15	18	21	24	27	29	29	29	29	29
H30ak	No	15	15	18	21	24	27	29	29	29	29	29
H30aj	No	15	15	17	20	24	26	28	29	29	29	29
N27aa	No	15	15	17	20	24	26	28	29	29	29	29
L20ad	No	15	15	17	20	23	26	28	29	29	29	29
I35ac	No	15	15	17	20	23	26	28	28	28	28	28
M14af	No	15	15	17	20	23	26	28	28	28	28	28

Name	Associated	Predicted Noise Level (dB(A)) for integer Hub Height Wind Speeds (m/s)										
		3	4	5	6	7	8	9	10	11	12	13
N35ab	No	15	15	17	20	23	26	28	28	28	28	28
O35ag	No	15	15	17	20	23	26	28	28	28	28	28
M14ah	No	15	15	17	20	23	26	28	28	28	28	28
N35ae	No	15	15	17	20	23	26	28	28	28	28	28
M14az	No	15	15	17	20	23	26	28	28	28	28	28
H29ac	No	15	15	17	20	23	26	28	28	28	28	28
N35aa	No	15	15	17	20	23	26	28	28	28	28	28
I34ad	No	15	15	17	20	23	26	28	28	28	28	28
I34aa	No	15	15	17	20	23	26	28	28	28	28	28
M14ag	No	15	15	17	20	23	26	28	28	28	28	28
J26ad	No	14	14	17	20	23	26	28	28	28	28	28
H30ac	No	14	14	16	19	22	25	27	28	28	28	28
I35ab	No	14	14	16	19	22	25	27	27	28	28	28
K13aa	No	14	14	16	19	22	25	27	27	27	27	27
H30am	No	14	14	16	19	22	25	27	27	27	27	27
H30ai	No	14	14	16	19	22	25	27	27	27	27	27
H30ad	No	14	13	16	19	22	25	27	27	27	27	27
Unnamed House 5	No	14	13	16	19	22	25	27	27	27	27	27
M20am	No	13	13	15	18	21	24	26	26	26	26	26